

**TECHNICAL AND ECONOMIC EVALUATION OF  
THE UTILISATION OF SOLAR ENERGY  
AT SOUTH AFRICA'S SANAE IV BASE IN ANTARCTICA**

Jürgen Richter Olivier

**Thesis presented in partial fulfilment of the requirements for the degree of  
MScEng in Mechanical Engineering  
Stellenbosch University**

Thesis supervisor:  
Professor T.M. Harms  
Department of Mechanical Engineering

DECEMBER 2005



## Declaration

I, the undersigned, hereby declare that the work contained in this thesis is my own original work and that I have not previously, in its entirety or in part, submitted it at any university for a degree.

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

*Jürgen R. Olivier*

## **Abstract**

There are numerous challenges that have to be overcome in order to generate the electrical and thermal energy required to power Antarctic research stations in a technically, economically and environmentally suitable manner. Consequently the costs associated with generating energy at these latitudes are high, and ways are constantly being sought to improve energy generation methods and protect the pristine environment. These endeavours are strongly encouraged by the Antarctic Treaty.

This thesis aims to investigate the technical and economic feasibility of using solar energy at South Africa's SANAE IV (South African National Antarctic Expedition IV) station in Antarctica. The idea of using solar energy in Antarctica is not novel, and as is shown a number of stations have already capitalised on opportunities to generate savings in this manner. Similarly, at SANAE IV, there exists the opportunity to alleviate an increased summer energy load on the station and reduce diesel consumption through the proper implementation of such a system. There is also ample scope to use wind energy, which would have a marked positive impact on the base's operation.

The data used in this thesis was obtained mainly during the 2004/2005 takeover expedition to South Africa's SANAE IV station in Antarctica. Included are measurements of total and diffuse radiation that were measured during the months of January and February 2005, and which form an important part of the investigation. Since there are currently no radiation sensors, or any historical record of measured radiation at the station, the only measured data available from SANAE IV was the data recorded during the 2004/2005 takeover expedition. By further collecting archived values of fuel consumption, electricity generation and load profiles, an energy audit of the station was also completed during the 2004/2005 takeover expedition.

The expected savings that could be generated by solar systems were calculated by considering the use of both photovoltaic and solar thermal devices at the South African station. The 40 kW photovoltaic system that was investigated was able to significantly reduce the load on the diesel-electric generators, however it was only possible to fully recover the initial costs sunk into commissioning the system after 21 years. The installation of such a system would equate to a Net Present Value of 302 915 Rand at the end of the 25 year system lifetime (assuming a real hurdle rate of 8 % and fuel price escalation rate of 5 %), saving 9 958 litres of diesel annually and

generating energy at a cost of 3.20 Rand/kWh. It should be noted, however, that under more ideal conditions (i.e. less attractive alternative investment opportunities, higher fuel price escalation rates and a stronger emphasis on environmental concerns) investment into a photovoltaic system could potentially breakeven after approximately 10-15 years, while simultaneously significantly improving base operation.

Furthermore, it was found that a flat-plate solar thermal collector utilised with the snow smelter at SANAE IV is better suited to generating savings than photovoltaic devices. The average cost of generating electricity after commissioning such a system with a 143 m<sup>2</sup> collector field would be approximately 3.13 Rand/kWh, as opposed to the 3.21 Rand/kWh of the current diesel-only system, and would realise an annual fuel saving of approximately 12 245 litres. The system would arrive at a breakeven point after approximately 6 years, and represent a Net Present Value of 2 148 811 Rand after 25 years. By further considering environmental factors such as the cost of removing soiled snow from Antarctica and diesel fuel emissions the magnitude of the net present savings would increase by approximately 500 000 Rand over the expected 25 year project lifetime.

The opportunity to install a solar energy system at SANAE IV therefore warrants action. There is potential not only to generate savings over the operational lifetime but also to preserve the environment in accordance with the desires of the Antarctic Treaty. It is firmly believed that with careful planning and implementation such a project can and should be successfully undertaken.

## Opsomming

'n Aantal unieke uitdagings moet oorkom word om die elektriese en termiese energie wat by navorsingstasies in Antarktika benodig word in 'n toepaslike tegniese, ekonomiese en omgewingsbewuste manier op te wek. Die kostes verbonde aan die gebruik van energie by hierdie breedtegrade is om hierdie rede hoog. Daar is dus ook geen einde nie aan die soektog vir beter maniere van energieopwekking en omgewingsbeskerming, pogings wat deur die Antarktiese Traktaat ondersteun word.

In hierdie tesis word daarna gemik om die tegniese en ekonomiese lewensvatbaarheid van die gebruik van sonenergie by Suid Afrika se SANAE IV (Suid Afrikaanse Nasionale Antarktiese Ekspedisie IV) basis in Antarktika te ondersoek. Die aanwending van sonenergie in Antarktika is geensins 'n nuwe idee nie, en soos hier gewys word het 'n aantal navorsings stasies alreeds van sulke bespaaringsgeleenthede gebruik gemaak. In dieselfde manier bestaan daar die geleentheid by SANAE IV om die verhoogde somerenergielas op die basis se energiestelsels, en diesel verbruik te verminder. Die aanwending van windenergie kan ook 'n merkbare positiewe verskil maak.

Hierdie tesis gebruik ook hoofsaaklik inligting wat versamel was gedurende die 2004/2005 ekspedisie na Suid Afrika se SANAE IV stasie in Antarktika. Ingesluit is lesings van totale en diffuse sonstralingsenergie gemeet gedurende die maande van Januarie en Februarie 2005, wat 'n belangrike rol speel in die opeenvolgende ondersoek. Tans is daar geen sensors wat sonstralingsenergie by SANAE IV meet nie, en ook geen historiese sonstralingsenergie data nie, en dus is die data wat gedurende die 2004/2005 ekspedisie versamel was die enigste huidige lesings van SANAE IV. Deur inligting te versamel gedurende die ekspedisie oor brandstofverbruik, elektrisiteitsopwekking en lasprofiele is 'n energie audit van die stasie ook voltooi.

Moontlike besparings wat deur die gebruik van sonenergiestelsels by Suid Afrika se basis gerealiseer kan word was bepaal deur die gebruik van beide fotovoltaaise en termiese stelsels te oorweeg. Verbeterde werkverrigting van dieselopwekkers is verkry met die gebruik van 'n 40 kW fotovoltaaise sisteem, alhoewel projekkostes slegs na 21 jaar herwin kan word. Die gebruik van so 'n stelsel sal 'n huidige waarde van 302 915 Rand verteeneewordig na die projekleef tyd van 25 jaar (gestel dat die *regte* hekkiekoers 8 % en brandstofstygingskoers 5 % is), jaarliks

omtrent 9 958 liter diesel bespaar en energie opwek teen 'n koste van 3.20 Rand/kWh. Onder meer voordelige omstandighede (m.a.w 'n hoë tempo van brandstof kosteverhogings, min aantreklike alternatiewe bellegings en 'n hoë klem op omgewingsake) sal 'n fotovoltaïese sisteem heel waarskynlik na 10-15 jaar kan gelykbreek, terwyl dit terselfdetyd 'n merkbare positiewe verskil sou maak aan die werksverrigting van die basis.

Daar is vasgestel dat 'n platplaat termiese sonkollektor by SANAE IV vir gebruik met die stasie se sneeusmelter die hoogste besparingspotensiaal het. Die gemiddelde energiekostes na die instalering van 'n platplaat termiese sonkollektorsisteem met 143 m<sup>2</sup> versamelveld sal ongeveer 3.13 Rand/kWh wees, in teenstelling met die 3.21 Rand /kWh van die huidige dieselstelsel. Daar sal ook jaarliks omtrent 12 245 liter diesel bespaar word. Die projekkostes hoort na 6 jaar gelyk te breek, en sal na 25 jaar 'n Netto Huidige Waarde van 2 148 811 Rand verteenwoordig. Deur verder te kyk na kostes verbonde aan die verwydering van dieselsbesmette sneeu en eselopwekker uitlaatgasse word die Netto Huidige Waarde met ongeveer 500 000 Rand vermeerder.

Die geleentheid om 'n sonenergiestelsel by die SANAE IV basis in gebruik te neem vereis daarom dringende aandag. In ooreenstemming met die inhoud van die Antarktiese Traktaat bestaan daar besliste besparingspotensiaal, tesame met die geleentheid tot omgewingsbeskeming. Met omsigte beplanning en uitvoering sou so 'n projek onderneem kon word en dit word gestel dat daarom ook behoort onderneem te word.

*“From whose womb comes the ice?  
Who gives birth to the frost from the heavens,  
When the waters become hard as stone,  
When the surface of the deep is frozen?  
Can you bind the beautiful Pleiades?  
Can you loose the cords of Orion?  
Can you bring forth the constellations in their seasons  
Or lead out the Bear with its cubs?”*

*- Job 38:29-32*



Lorentzenpiggen, a mountain peak located directly south of SANAE IV (Olivier, 2005)

## Acknowledgements

I would like to thank the following people and institutions for providing valuable assistance during the course of this study:

- Professor Thomas M. Harms, as thesis supervisor, for his encouragement, guidance and insight that has added greatly to this project.
- Mr. Franz Hoffman, co-ordinator of the 2004/2005 SANAE IV takeover expedition, for his administrative assistance that made it possible for me to join the 2004/2005 takeover expedition to SANAE IV and obtain much of the data required for this study.
- Mr. Daniël J. Esterhuyse, from the South African Weather Services, for his advice regarding the measurement of solar radiation, and his assistance in obtaining the pyranometers that were used to measure solar radiation at SANAE IV during the 2004/2005 takeover expedition.
- Mr. Cobus J. Zietsman, from the University of Stellenbosch, for his assistance in obtaining many of the accessories required for measuring solar radiation at SANAE IV, and for his endless patience and keen insights offered during the preparations for the SANAE IV 2004/2005 takeover expedition.
- The South African Department of Environmental Affairs and Tourism, Subdirectorates Antarctica and Islands, for funding and logistical support, as well as the South African Department of Science and Technology who through the South African National Research Foundation also contributed in funding.
- To those, including friends and colleagues, but especially my parents, who gave of their time to listen, discuss, or just reflect over some of the difficulties that this project presented.

# Table of Contents

DECLARATION.....	iii
ABSTRACT.....	iv
OPSOMMING.....	vi
ACKNOWLEDGEMENTS.....	ix
TABLE OF CONTENTS.....	x
LIST OF FIGURES.....	xiii
LIST OF TABLES.....	xvi
NOMENCLATURE.....	xviii
ABBREVIATIONS.....	xx
<i>CHAPTER 1 – INTRODUCTION.....</i>	<i>1</i>
1.1 Background.....	1
1.2 Objectives.....	4
1.3 Layout of Thesis.....	6
<i>CHAPTER 2 – AVAILABLE SOLAR ENERGY AT SANAE IV IN ANTARCTICA.....</i>	<i>8</i>
2.1 Introduction.....	8
2.2 Global Databases – A First Estimate.....	9
2.3 Solar Radiation at SANAE IV – A Theoretical Study.....	12
2.3.1 Data Capture Instrumentation and Procedures.....	12
2.3.2 Clear-Sky Radiation.....	12
2.3.3 All-Sky Conditions.....	14
2.4 Summary.....	23
<i>CHAPTER 3 – SANAE IV ENERGY DEMAND.....</i>	<i>24</i>

3.1 Introduction.....	24
3.2 Base Operating Systems.....	25
3.2.1 SANA E’s Five-fold Operating System.....	25
3.2.2 Water Systems.....	26
3.2.3 Heating and Ventilation System.....	30
3.2.4 Power Generation System.....	30
3.2.5 PLC System.....	32
3.2.6 Sewage System.....	32
3.3 Fuel Consumption and Energy Demand.....	33
3.3.1 Temporal Variations of Energy Demand.....	35
3.4 Summary.....	38
<i>CHAPTER 4 – SOLAR ENERGY CAPTURING SOLUTIONS.....</i>	<i>39</i>
4.1 Introduction.....	39
4.2 Solar Electric Collectors.....	40
4.2.1 Background.....	40
4.2.2 Implementing Photovoltaics at SANA E IV.....	42
4.2.3 Expected Efficiencies of Photovoltaic Panels at SANA E IV.....	42
4.3 Solar Thermal Collectors.....	48
4.3.1 Selection of Solar Thermal Collectors.....	50
4.4 Summary.....	57
<i>CHAPTER 5 – ECONOMIC ANALYSIS.....</i>	<i>58</i>
5.1 Introduction.....	58
5.2 Basic Investment Costs.....	59
5.3 Investment Costs of Supplementary Infrastructure and Electrical Connections to SANA E IV’s Electrical Grid.....	60
5.4 Annual Recurring Costs and Savings.....	60

5.5 Economic Viability Criteria Necessary to Evaluate Investments for Solar Energy Systems.....	61
5.6 Externalities.....	62
5.7 Diesel Price.....	63
5.8 Economic Assessment.....	64
5.8.1 Photovoltaic Energy System Assessment.....	64
5.8.2 Solar Thermal Energy System Assessment.....	71
5.8.3 Economic Performance Criteria at Various Financial Conditions.....	76
5.9 Summary.....	77
<i>CHAPTER 6 – CONCLUSION</i> .....	78
REFERENCES.....	82
APPENDIX A: ADDITIONAL INFORMATION TO INTRODUCTION.....	87
APPENDIX B: RADIATION CALCULATIONS.....	94
APPENDIX C: ADDITIONAL INFORMATION TO SANAE IV ENERGY DEMAND.....	104
APPENDIX D: ADDITIONAL INFORMATION TO SOLAR ENERGY CAPTURING SOLUTIONS.....	116
APPENDIX E: ADDITIONAL INFORMATION TO ECONOMIC ANALYSIS.....	128

## List of Figures

Figure 1.1	SANAE IV located in Queen Maud Land (Perry-Castañeda, 2005).....	1
Figure 1.2	South Africa’s SANAE IV base atop Vesleskarvet, a rocky outcrop (Olivier, 2005).....	2
Figure 1.3	Map of SANAP operations in Antarctica (Theodora Maps, 2005).....	3
Figure 1.4	South Africa’s SANAE IV station, completed in 1997 (Olivier, 2005).....	4
Figure 1.5	Where the Antarctic Ice-Shelf, suspended in the ocean, breaks off into icebergs (Olivier, 2005).....	5
Figure 1.6	Joint German and South African logistics on the ice-shelf (Olivier, 2005).....	7
Figure 2.1	Estimated average total all-sky global horizontal insolation (SSE, 2005).....	9
Figure 2.2	Estimated average December total horizontal insolation (SSE, 2005).....	10
Figure 2.3	Surface and TOA horizontal insolation at SANAE IV, 1988 to 1992 (SSE, 2005).....	11
Figure 2.4	Monthly-average global horizontal radiation at SANAE IV (SSE, 2005).....	11
Figure 2.5	Clear-sky curves of daily radiation at SANAE IV.....	13
Figure 2.6	Five-year average January daily radiation at Neumeyer station (1994 to 1998).....	16
Figure 2.7	Comparison of SANAE IV data with values predicted by the SSE dataset.....	17
Figure 2.8	Components of beam and diffuse radiation (Duffie et al., 1991).....	18
Figure 2.9	January daily insolation rates on a tilted surface with different ground reflectivity.....	19
Figure 2.10	Expected daily beam insolation on a tilted surface with different ground reflectivity.....	20
Figure 2.11	Typical Measured and predicted values of radiation for a surface tilted at 40°	21
Figure 2.12	Monthly-average global horizontal radiation at four Antarctic stations.....	22
Figure 3.1	Energy systems at SANAE IV use only electricity and generator waste heat...	26
Figure 3.2	The snow smelter (SANAE IV database, 2005).....	28
Figure 3.3	Peak power demand breakdown of energy consumers (updated from Teetz, 2002).....	31
Figure 3.4	Diesel bunker located 400 m from the base (Olivier, 2005).....	33
Figure 3.5	Generator diesel usage from the years 2000, 2001, 2002 and 2004.....	34
Figure 3.6	Monthly variations of diesel consumption.....	36

Figure 3.7	Average load profiles.....	37
Figure 3.8	Minimum and average generator load profile at SANAE IV.....	37
Figure 4.1	SANAE IV solar energy system.....	39
Figure 4.2	Apportioned photovoltaic production in 2003, and historical trend (EPIA, 2005).....	40
Figure 4.3	Costs of renewable and other energy generation methods (Broniki, 2001).....	41
Figure 4.4	Photovoltaic prices from 1975 to 1998 (Maycock, 1999).....	41
Figure 4.5	SANAE IV solar energy system implementing photovoltaic panels.....	42
Figure 4.6	Breakdown of available solar technology (SANYO, 2005).....	43
Figure 4.7	RETScreen On-Grid Energy Model flowchart.....	45
Figure 4.8	The solar thermal system installed at Australia's Davis station (AAD, 2005).....	51
Figure 4.9	Efficiencies of three available flat-plate solar thermal collectors.....	52
Figure 4.10	SANAE IV solar energy system implementing solar thermal collectors.....	52
Figure 4.11	Physical connection of solar thermal collector to snow smelter system.....	53
Figure 4.12	Basic logic behind snow smelter simulation programme.....	54
Figure 4.13	Sample results from snow smelter simulation programme.....	54
Figure 4.14	The Solahart PowerPack system installed at the Davis Station (Solahart, 2005).....	56
Figure 5.1	NPV of costs incurred during expected project lifetime.....	66
Figure 5.2	NPV of the difference between the costs of the two alternatives.....	67
Figure 5.3	NPV after 25 years at various initial capital investments (8 % MARR).....	67
Figure 5.4	IRR at various initial capital investments.....	68
Figure 5.5	BC Ratio over lifespan of project.....	69
Figure 5.6	BC Ratio at various capital investments.....	70
Figure 5.7	Energy generation costs of diesel only and hybrid systems.....	71
Figure 5.8	NPV of the difference between the costs of the two alternatives.....	73
Figure 5.9	NPV after 25 years at various initial capital investments (8 % MARR).....	74
Figure 5.10	IRR at various initial capital investments.....	75
Figure 5.11	BC Ratio at various capital investments.....	75
Figure 5.12	Energy generation costs of diesel only and hybrid systems.....	76
Figure A.1	SANAE IV in Queen Maud Land, Antarctica (Theodora Maps, 2005).....	87
Figure A.2	SANAE IV, distances in Nautical Miles (de Wet, 2005).....	87

Figure A.3	Territorial claims and overwintering stations (Perry-Castañeda, 2005).....	88
Figure A.4	View from SANAE IV (SANAE IV database, 2005).....	89
Figure C.1	Contribution required by A-Block FCU to compensate for heat losses from the base.....	106
Figure C.2	Graphs of electricity consumers in each block.....	110
Figure C.3	Graphs of generator diesel consumption and electrical generation.....	115
Figure D.1	Characteristics of the standard types of solar collectors (Huang et al., 2001)...	116
Figure D.2	Potential solar thermal collector set-up.....	117
Figure D.3	Thermomax product price sheet (Thermomax, 2005).....	119
Figure D.4	Solahart M-Collector specifications (Solahart, 2005).....	120
Figure D.5	Solahart Bt-Collector specifications (Solahart, 2005).....	121

## List of Tables

Table 2.1	Hottel climate coefficients.....	14
Table 2.2	Estimated January radiation averages for the conditions at SANAE IV.....	18
Table 2.3	Expected monthly-average daily totals of insolation at SANAE IV.....	21
Table 3.1	Energy requirements of takeover water demand.....	29
Table 3.2	Electricity consumption data, 2005.....	31
Table 3.3	Properties of SAB.....	33
Table 3.4	Average annual fuel consumption by type.....	33
Table 3.5	Average annual fuel consumption by user.....	34
Table 4.1	Local South African suppliers of photovoltaic panels.....	43
Table 4.2	Expected January efficiencies at ambient SANAE IV conditions.....	44
Table 4.3	Heat transfer analysis of photovoltaic panels.....	45
Table 4.4	PV module characteristics for standard technologies (RETScreen, 2005)...	47
Table 4.5	RETScreen analysis of PV panels (using equations 4.3 – 4.7 and inverter efficiencies).....	47
Table 4.6	Expected efficiencies and daily energy capture from different PV technologies.....	48
Table 4.7	Currently installed renewable energy systems in Antarctica (COMNAP, 2005).....	49
Table 4.8	Estimated daily load for snow smelter with and without Bt collector system.....	55
Table 4.9	Energy savings generated at snow smelter from Bt collector system.....	55
Table 5.1	Total annual emissions from generators (Taylor et al., 2002).....	62
Table 5.2	Cost of pollutants (Teetz, 2002).....	62
Table 5.3	Diesel costs for use in Antarctica.....	64
Table 5.4	Essential data and system characteristics of PV System.....	65
Table 5.5	PV System results after 25 years.....	68
Table 5.6	Essential data and system characteristics of solar thermal system.....	72
Table 5.7	Solar thermal system results after 25 years.....	74
Table 5.8	Financial outcomes under various economic conditions.....	76
Table A.1	Dimensions of SANAE IV.....	90
Table C.1	A-Block summer and winter conditions suggested by Cencelli (2002).....	105

Table C.2	A-Block electricity consumers.....	108
Table C.3	B-Block electricity consumers.....	109
Table C.4	C-Block electricity consumers.....	109
Table C.5	Data collected on generator load profiles.....	111
Table C.6	Generator diesel consumption and electrical power generation.....	114
Table D.1	Summary of solar thermal collector systems.....	118
Table D.2	Estimated daily load for snow smelter with and without Thermomax collector system.....	125
Table D.3	Energy savings generated at snow smelter from Bt collector system.....	126
Table D.4	Estimated daily load for snow smelter with and without Mt collector system.....	126
Table D.5	Energy savings generated at snow smelter from Bt collector system.....	127
Table D.6	System performance comparison.....	127
Table E.1	Sample results for the solar PV system (column A is for diesel-only and column B is for the hybrid system).....	130
Table E.2	Sample results for the solar PV system (column A is for diesel-only and column B is for the hybrid system).....	131

## Nomenclature

### **Engineering Symbols:**

$A$	= Area	[m <sup>2</sup> ]
$A_o$	= Area on the outside of heat exchanger	[m <sup>2</sup> ]
$Al$	= Altitude	[km]
$C_p$	= Thermal heat capacity	[kJ/kg. K]
$E$	= Available energy	[J]
$FC$	= Fuel Consumption	[Litres]
$G$	= Global radiation incident on a horizontal surface	[W/m <sup>2</sup> ]
$G_{cnb}$	= Clear-Sky normal beam radiation	[W/m <sup>2</sup> ]
$G_d$	= Diffuse radiation on a horizontal surface	[W/m <sup>2</sup> ]
$G_o$	= Top of atmosphere radiation on a horizontal surface	[W/m <sup>2</sup> ]
$G_{on}$	= Top of atmosphere radiation on a surface normal to the incoming rays	[W/m <sup>2</sup> ]
$\bar{H}$	= Monthly-average daily insolation on a horizontal surface	[kWh/m <sup>2</sup> ]
$\bar{H}_o$	= Monthly-average daily top of atmosphere insolation on a horizontal surface	[kWh/m <sup>2</sup> ]
$\bar{K}_T$	= Monthly-average clearness index	[ ]
$K_T$	= Daily-average clearness index	[ ]
$k_T$	= Hourly-average clearness index	[ ]
$\dot{m}$	= Mass flow-rate	[kg/s]
$NOCT$	= Nominal Operating Cell Temperature	[°C]
$P$	= Power	[W]
$PP$	= Power Production	[kWh]
$Q$	= Heat transfer	[J]
$\dot{Q}$	= Rate of heat transfer	[J/s]
$R_T$	= Thermal resistance	[K/(W/m <sup>2</sup> )]
$T$	= Temperature	[K]
$U_o$	= Overall outside heat transfer coefficient	[W/m <sup>2</sup> K]

### **Greek Engineering Symbols:**

$\Delta T$	= Temperature difference	[K]
$\rho$	= Reflectivity	[ ]
$\beta$	= Tilt of collecting surface away from horizontal (i.e. for a wall $\beta = 90^\circ$ )	[°]
$\beta_p$	= Temperature coefficient of module efficiency	[%/°C]
$r$	= Climate coefficient	[ ]
$\tau$	= Radiation transmissivity	[ ]
$\theta_z$	= Angle between incoming rays and zenith (i.e. at sunset $\theta_z = 90^\circ$ )	[°]
$\eta$	= Efficiency	[ ]
$\mu_T$	= Percentage decrease in efficiency with increase in temperature	[%/°C]
$\lambda$	= Energy losses	[%]

### **Economic Symbols:**

$BC$	= Benefit Cost ratio	[ ]
$C$	= Capital investment	[Rand]
$F$	= Fuel costs	[Rand]
$i$	= Interest rate	[%]
$IRR$	= Internal Rate of Return	[%]
$L$	= Labour costs	[Rand]
$M$	= Maintenance costs	[Rand]
$MARR$	= Minimum Attractive Rate of Return	[%]
$R$	= Rand (i.e. South African currency)	[Rand]
$n$	= Time	[Years]
$NAW$	= Net Annual Worth	[Rand]
$NPV$	= Net Present Value	[Rand]
$LCC$	= Life Cycle Costs	[Rand]
$O \& M$	= Operation and Maintenance costs	[Rand]
$PW$	= Present Worth	[Rand]
$PWF$	= Present Worth Factor	[ ]
$US\$$	= American dollars	[Dollars]
$X$	= Externalities	[Rand]

## Abbreviations

AAD	Australian Antarctic Division
AC	Alternating Current
AHU	Air Handling Unit
ASHRAE	American Society of Heating, Refrigerating and Air-Conditioning Engineers
ATSCM	Antarctic Treaty Special Consultative Meeting
AUD	Australian Dollar
BC Ratio	Benefit to Cost Ratio
BSRN	Baseline Surface Radiation Network
CEP	Committee for Environmental Protection
CO	Carbon Monoxide
CO <sub>2</sub>	Carbon Dioxide
COMNAP	Council of Managers of National Antarctic Programs
DC	Direct Current
DEAT	South African Department of Environmental Affairs and Tourism
FCU	Fan Coil Unit
FRA	France
GEF	Global Environment Facility
GER	Germany
H&V	Heating and Ventilation System
HIT	Heterojunction with Intrinsic Thin layer
Hz	Hertz (i.e. cycles per second)
IEA	International Energy Agency
IGY	International Geophysical Year
IND	India
IRR	Internal Rate of Return
JAP	Japan
L	Litre
LCC	Life Cycle Costs
LPG	Liquid Petroleum Gas
MPPT	Maximum Power Point Tracker
NASA	National Aeronautic and Space Agency
NAW	Net Annual Worth

NOR	Norway
No <sub>x</sub>	Oxides of Nitrogen
NPV	Net Present Value
O&M	Operation and Maintenance
PLC	Programmable Logic Controller
PM	Particulate Matter
PV	Photovoltaic
PW	Present Worth
PWF	Present Worth Factor
R	South African Rand (i.e. South African currency)
ROW	Rest Of World
RUS	Russia
SAB	Special Antarctic Blend (i.e. special freeze resistant diesel)
SANAE IV	South African National Antarctic Expedition IV, or South Africa's fourth base in Antarctica. The Roman numeral is in reference to a base.
SANAE 4	South African National Antarctic Expedition 4, or the fourth South African team to have overwintered on Antarctica (in 2005 SANAE 44 overwintered at SANAE IV). The ordinary numeral is in reference to a team of people.
SANAP	South African National Antarctic Programme (which administrates activities on South African controlled Southern Ocean islands as well as at SANAE IV)
SAWS	South African Weather Services
SCAR	Scientific Committee on Antarctic Research
SO <sub>2</sub>	Sulphur Dioxide
SRB	Surface Radiation Budget dataset collated by NASA
SSE	Surface meteorology and Solar Energy dataset collated by NASA
STC	Standard Testing Conditions
SWE	Sweden
TOA	Top Of Atmosphere
UNEP	United Nations Environment Programme
US\$	American Dollars (i.e. American currency)
VLF	Very Low Frequency
VOC	Volatile Organic Compounds



# Chapter 1 – Introduction

## 1.1 Background

South Africa's current Antarctic station, named the South African National Antarctic Expedition IV (SANAE IV), is positioned at 70° 40' 25" South and 2° 49' 44" West, approximately 4 500 km from Cape Town in South Africa and 3 000 km from the geographical South Pole. The base is one of seven overwintering stations (viz. Maitri [IND], Molodezhnaya [RUS], Neumeyer [GER], Novolazarevskaya [RUS], Syowa [JAP], SANAE IV [SA] and Troll [NOR]) operational in Queen Maud Land during the winter and one of fifteen stations to run programmes in Queen Maud Land during the summer (SCAR, 2005). The German Neumeyer and Norwegian Troll stations are SANAE IV's closest neighbours (located approximately 300 km to the northwest and 360 km to the east respectively) and in conjunction with SANAE IV are three of forty-seven overwintering stations that currently operate in Antarctica and the surrounding islands (an area collectively referred to as the Antarctic) all year round.



Figure 1.1: SANAE IV located in Queen Maud Land (Perry-Castañeda, 2005)

All of these countries administrating stations in the Antarctic do so under the terms of the Antarctic Treaty. Established in Washington on 1 of December 1959, this treaty was one outcome of the 1<sup>st</sup> International Geophysical Year (IGY), the first scientific research effort to undertake concurrent scientific activities that spanned the globe. Forty-five countries have since ratified the Antarctic Treaty, although originally only twelve had signed the agreement in 1959. South Africa was one of the original twelve signatories. South Africa is currently also: one of

twenty-seven consultative parties to the Antarctic Treaty, a member of the Council of Managers of National Antarctic Programmes (COMNAP), a member of the Committee for Environmental Protection in Antarctica (CEP) and a national member of the Scientific Committee on Antarctic Research (SCAR). Furthermore, since the first South African overwintering team was dispatched to the SANAE I station in 1961, forty-four expeditions have overwintered on the continent, and carried out numerous scientific and logistical activities.



Figure 1.2: South Africa's SANAE IV base atop Vesleskarvet, a rocky outcrop (Olivier, 2005)

Currently expeditions to SANAE IV allow South Africa the opportunity to participate in a number of projects requiring not only proximity to the magnetic South Pole but also a high level of scientific expertise. In conjunction with Britain and Japan, for example, South Africa is a partner in the internationally collaborative SHARE project. SHARE contributes to the larger worldwide Super Dual Auroral Radar Network (SuperDARN) used to study electric fields, velocities and irregularities of the Earth's upper atmosphere by investigating data obtained from fifteen radar stations around the globe (nine in the Northern Hemisphere and six in the Southern Hemisphere). Ultimately this information is used to study changes in the Earth's biosphere that shields life from harmful cosmic rays.

South Africa also participates in the Solar Terrestrial Energy Programme (STEP), which investigates energy-transfer processes in the Earth's magnetosphere and ionosphere. By using magnetometers, auroral imaging devices, Very Low Frequency (VLF) direction finding systems

and a host of other instrumentation, the processes that are known to “...*disrupt radio communications, cause damage to satellites, disrupt or destroy large networks of electric power lines and on occasion threaten astronauts and Concorde passengers with harmful levels of proton fluxes*” (SANAP, 2005) can be studied.

Neutron count-rates are also recorded and forwarded to global data-centres, assisting research into ground-based solar events initiated by changes on the sun’s surface. Total ozone column and UV-fluxes are monitored to supplement satellite measurements, making it possible to calculate the size of the Earth’s ozone hole. The Southern Hemisphere telemetry for Sweden’s Astrid-2 satellite is operated from the station, and can be used in a joint Swedish, Danish and South African collaboration by incorporating the Oersted satellite. This has allowed South Africa access to all data and software on the satellite in return for simultaneous ground-based aurora, magnetometer and VLF radio-wave measurements. Through SANAE IV South Africa also contributes to the IGS Programme (International GPS for Geodynamics Programme, involving 140 other partners), undertakes geological studies, serves as a weather station for the SAWS (South African Weather Services), is the centre for casualty evacuations in Queen Maud Land and is a partner with Germany in joint logistical operations.

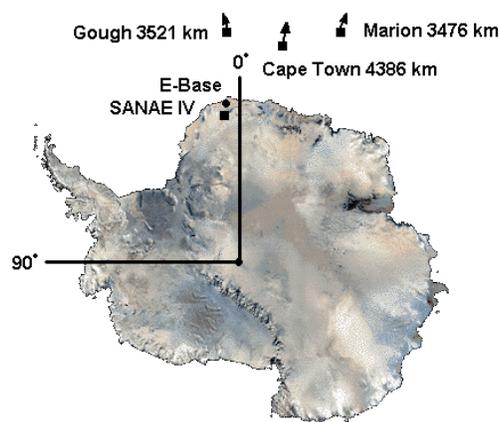


Figure 1.3: Map of SANAP operations in Antarctica (Theodora Maps, 2005)

Yet SANAE IV is not the only South African station in the Antarctic (refer to figure 1.3). South African Southern Ocean research stations also include: Marion Island (located 3 476 km from SANAE IV), Gough Island (3 521 km from SANAE IV) and E-Base (which exists purely in case of emergencies at SANAE IV and has no personnel that reside there). The necessary provisions are supplied to these stations by South Africa’s well-known ice-reinforced relief vessel, the SA-